

Chemical Design Factor – Effect of Liquid Hydrocarbons on PE Pipe Design Pressure

AGA PMC Meeting
September 12, 2016

Dr. Gene Palermo

Palermo Plastics Pipe (P³) Consulting

www.plasticspipe.com

PPI TR-9

Table 1 - Maximum Recommended Chemical Design Factors for Continuous Liquid Hydrocarbon Exposure

Pipe Material	Chemical Design Factor (DF _c)
PA – polyamide	1.00
PE – polyethylene	0.50
PVC – poly (vinyl chloride)	0.50

GPTC Guide Material – Part 192.123

“Design Limitations for Plastic Pipe”

4 EFFECTS OF LIQUID HYDROCARBONS

4.1 General.


Liquid hydrocarbons such as gasoline, diesel fuel, and condensates, either inside the pipe or in the surrounding soil, are known to have a detrimental effect on PE and PVC plastic piping materials.

PA piping is not affected by liquid hydrocarbons. Contact the piping manufacturer for specific recommendations.

GPTC Recommendation

TABLE 192.123i

Pipe Material	Chemical Design
	Factor (DF_c)
PA (polyamide)	1.00
PE (polyethylene)	0.50
PVC (polyvinyl chloride)	0.50

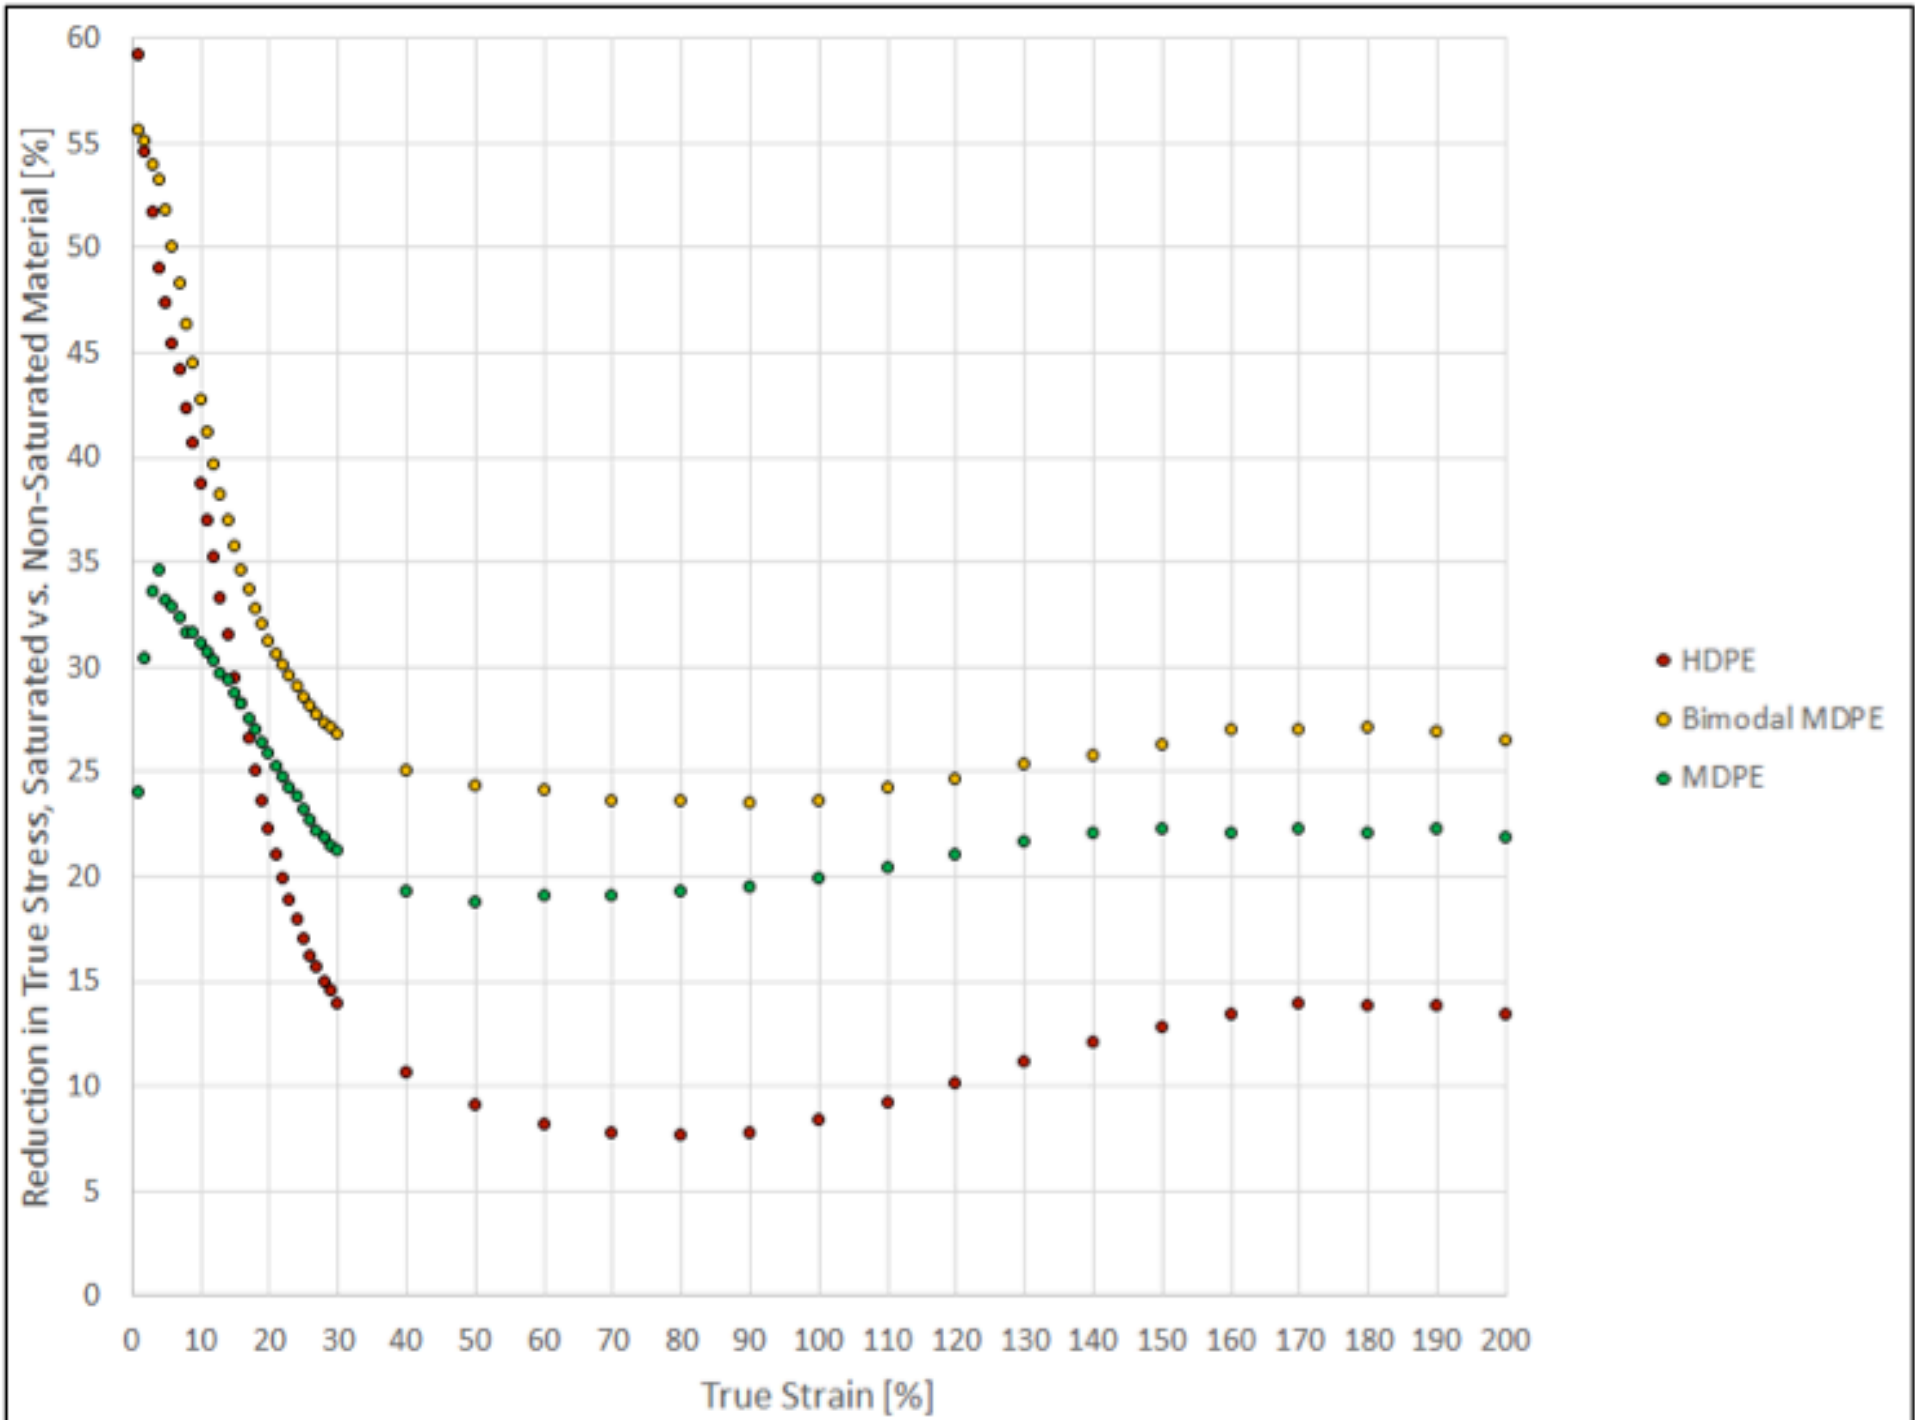

How does the gas distribution industry use the information in this GTI Report that was funded by PHMSA and is currently on the PHMSA website?

New PPI Technical Report

- **Based on GTI Report, PPI initiated a new Project to develop a new Technical Report – TC 2016-01**
- **“Chemical Design Factor for PE Pipe in the Presence of Liquid Hydrocarbons”**
- **First ballot has been issued and task group will review results of the ballot at the PPI meeting in Dallas in two weeks.**

Outline for new PPI TR

- **Background Information**
- **Shipment of Pipe Samples for Testing**
- **PE Pipe Test Protocol**
- **Chemical Design Factor Calculation**

Shipping Your Pipe

- To determine the appropriate chemical design factor for your pipeline, you first need to **contact the lab and ship them a sample**
- Pipe samples need to be cut and immediately packaged to **prevent the liquid hydrocarbon from evaporating** from the pipe sample.

Shipping Protocol - 1

- 1) Mark or document on the sample pipe the orientation where the hydrocarbon saturation is suspected.
- 2) Immediately wrap the pipe with a non-absorptive material such as Tedlar. If Tedlar is not available, wrapping the sample in **aluminum foil followed by an overwrap using a household plastic wrap** will achieve the same protective purpose

Shipping Protocol - 2

- 3) Place the wrapped pipe in a cooler. Use **frozen ice packs or gel packs** to keep the sample cold. It is imperative to keep the sample cold to prevent desorption.
- 4) **Ship the cooler overnight** to the testing lab.
- 5) Include chain of custody (COC) documentation with the sample. The area of exposure should also be noted on the COC.

Test Specimens

- To determine the long-term chemical design factor for PE pipe that has absorbed some heavy hydrocarbons (HHC) in the field, the test laboratory must determine the true stress at true strain for both the **“wet” as-received PE pipe sample** and for the **corresponding “dry” PE pipe sample**.
- Tensile test specimens are obtained by die-punching **ASTM D638 Type-V** specimens out of both the **“wet” as-received pipe sample** and **unsaturated “dry” pipe samples**.

Sample Testing

- All tests are performed on a universal tensile testing machine with a video extensometer in order to obtain the complete true stress-strain curves of the PE materials.
- A pull rate of **10% engineering strain** per second (0.7625 mm/s) is used for all tests.
- Specimens are acclimated to the test temperature for at least 1 hour.

Test Protocol - 1

- 1) Remove all wrapping from the cooled “as-received” pipe sample from the field.
- 2) **Cut the pipe sample in half. One half is the “wet” sample and the other half will be “dried” later.**
- 3) Punch out ASTM D638 Type-V specimens from the “wet” sample.
- 4) Obtain the true stress-strain curve at the **desired test temperature** using the tensile test machine at 10% strain per second.

Test Protocol - 2

- 5) Determine the **true stress at 40% strain** for the **“wet” sample**.
- 6) Dry the other half of the pipe sample in an oven to remove all liquid hydrocarbons
- 7) Repeat steps 3, 4 and 5 for the **“dry” sample**.
- 8) Calculate the **stress reduction factor (SRF)**, which is:

Stress Reduction Factor

**SRF = true stress at 40% strain - “wet” sample
true stress at 40% strain - “dry” sample**

Chemical Design Factor

- For PE pipe used in gas applications, the **chemical design factor (DF_C)** is calculated from the **stress reduction factor (SRF)** that was obtained in the previous section on the “wet” and “dry” PE pipe samples.
- **If the SRF is 0.90**, this means there is a 10% reduction in the true stress of the “wet” as-received pipe as compared to the control “dry” pipe. Thus, the **DF_C is 0.90**.

Design Pressure Calculation per DOT Part 192.121

$$P = \frac{2 (S) (DF_s) (DF_c)}{(DR - 1)}$$

P = design pressure, psig

S = hydrostatic design basis, psi

DF_s = design factor for the application – gas

DF_c = chemical design factor

DR = dimension ratio of the pipe

Example Calculation - 1

- What is the design pressure for a **DR 11 PE 4710** pipe operating at an average annual ground temperature of **65° F** in a gas distribution application in soil that has been **contaminated with diesel fuel**?
- Based on laboratory testing of the pipe, the stress reduction factor has been determined to be **0.87**.

Example Calculation

$$P = \frac{2 (S) (DF) (DF_c)}{(DR - 1)}$$

$$P = \frac{2 (1600) (0.32) (0.87)}{(11 - 1)}$$

P = 89 psig for a gas application

Effect of Liquid Hydrocarbon on PE Design Pressure

- The design pressure for this pipe without a liquid hydrocarbon is **102 psig**
- In the presence of liquid hydrocarbons in the soil the chemical design factor was calculated to be **0.87, or a 13% reduction** in the HDB
- This results in a 13% reduction in the design pressure, or **89 psig**
- This is considerable better than a **50% reduction** in design pressure, which would be **51 psig**

Example Calculation - 2

- What is the design pressure for a **DR 11 PE 2708** pipe operating at an average annual ground temperature of **65° F** in a gas distribution application in which **liquid hydrocarbon in the natural gas inside the pipe has penetrated into the pipe wall – i.e. bubbles are present during heating?**
- Based on laboratory testing of the pipe, the stress reduction factor has been determined to be **0.93**.

Example Calculation

$$P = \frac{2 (S) (DF) (DF_c)}{(DR - 1)}$$

$$P = \frac{2 (1250) (0.32) (0.93)}{(11 - 1)}$$

P = 74 psig for a gas application

Effect of Liquid Hydrocarbon on PE Design Pressure

- The design pressure for this pipe without a liquid hydrocarbon is **80 psig**
- In the presence of liquid hydrocarbons inside the pipe the chemical design factor was calculated to be **0.93, or a 7% reduction** in the HDB
- This results in a 7% reduction in the design pressure, or **74 psig**
- This is considerable better than a **50% reduction** in design pressure, which would be **40 psig**

Need Testing?

- For additional information on how **GTI** can test your pipeline to **determine the chemical design factor in the presence of liquid hydrocarbons** (from inside or outside the pipe) contact:

Dr. Gene Palermo

gpalermo@plasticpipe.com

(865) 995-1156

Dennis Jarnecke- GTI

Dennis.Jarnecke@gastechnology.org

(847) 544-3415

THE END

Prepared by
Palermo Plastics
Pipe (P³) Consulting