

~ 1.1% of the oil from the longest pipeline segment (123.5 to ML 167) along Lake Ashtabula needs to reach the reservoir at normal pool level (el. 1266) to exceed the benzene drinking water standard Maximum Contaminant Level of 0.005 mg/l

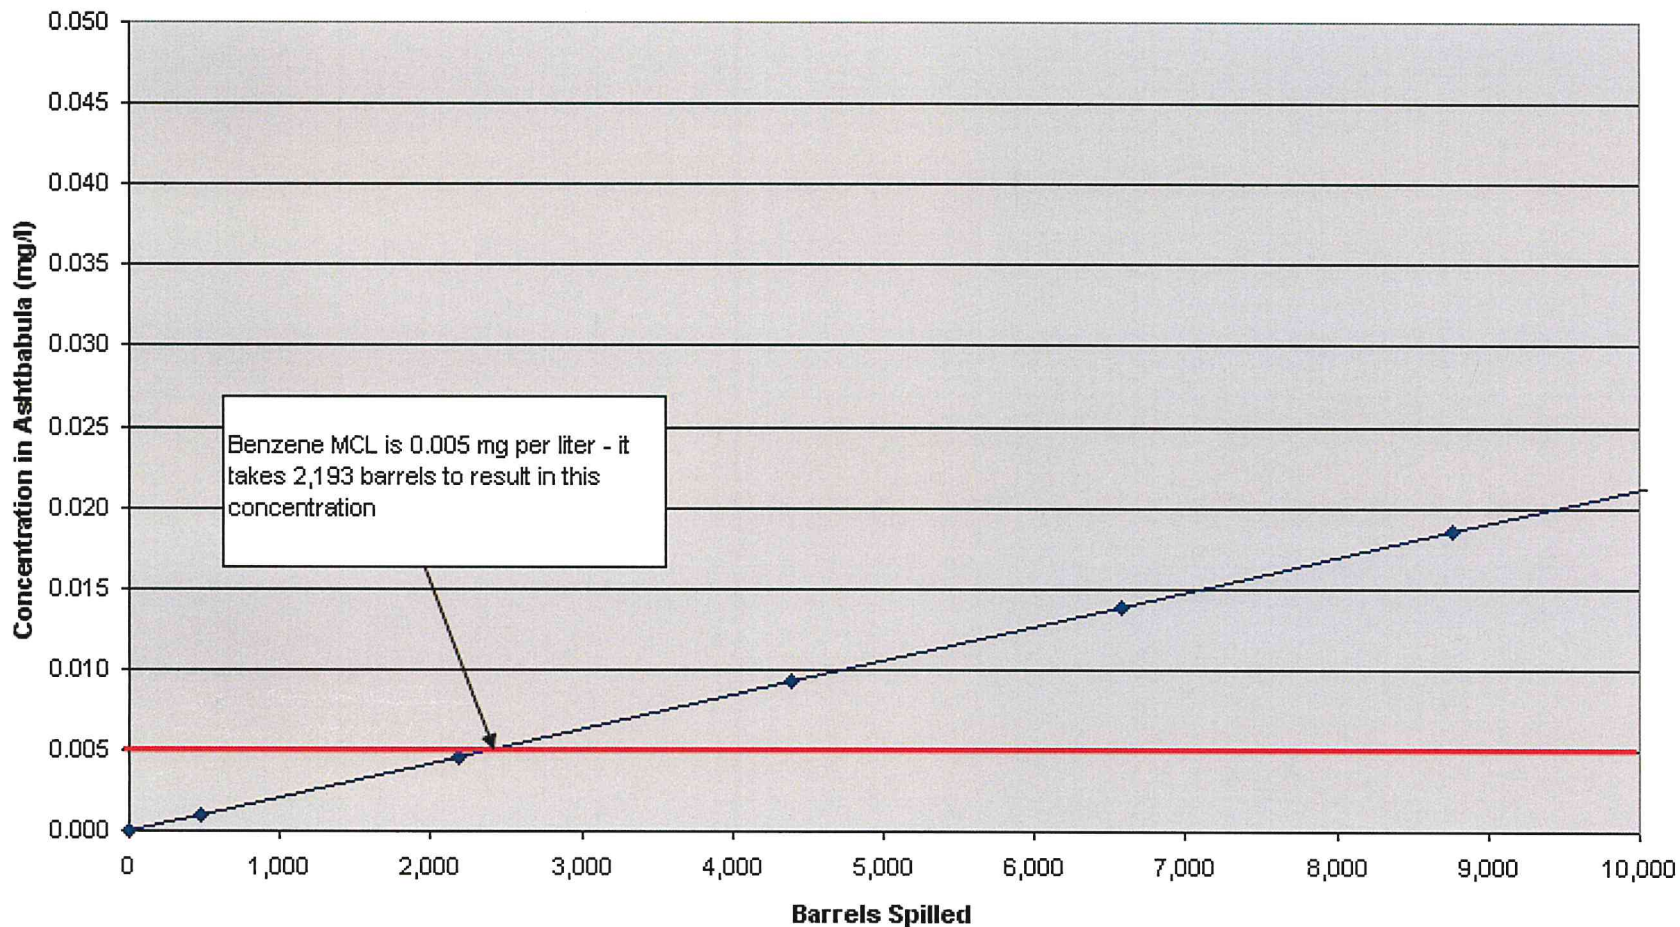


EXHIBIT
FGO 12-7