


Sunflower Wind Project  
Application for North Dakota  
Certificate of  
Site Compatibility

Figure 5A  
Exclusion and  
Avoidance Areas  
Vestas 2.0 V-110

Morton and Stark Counties, ND  
February 2014

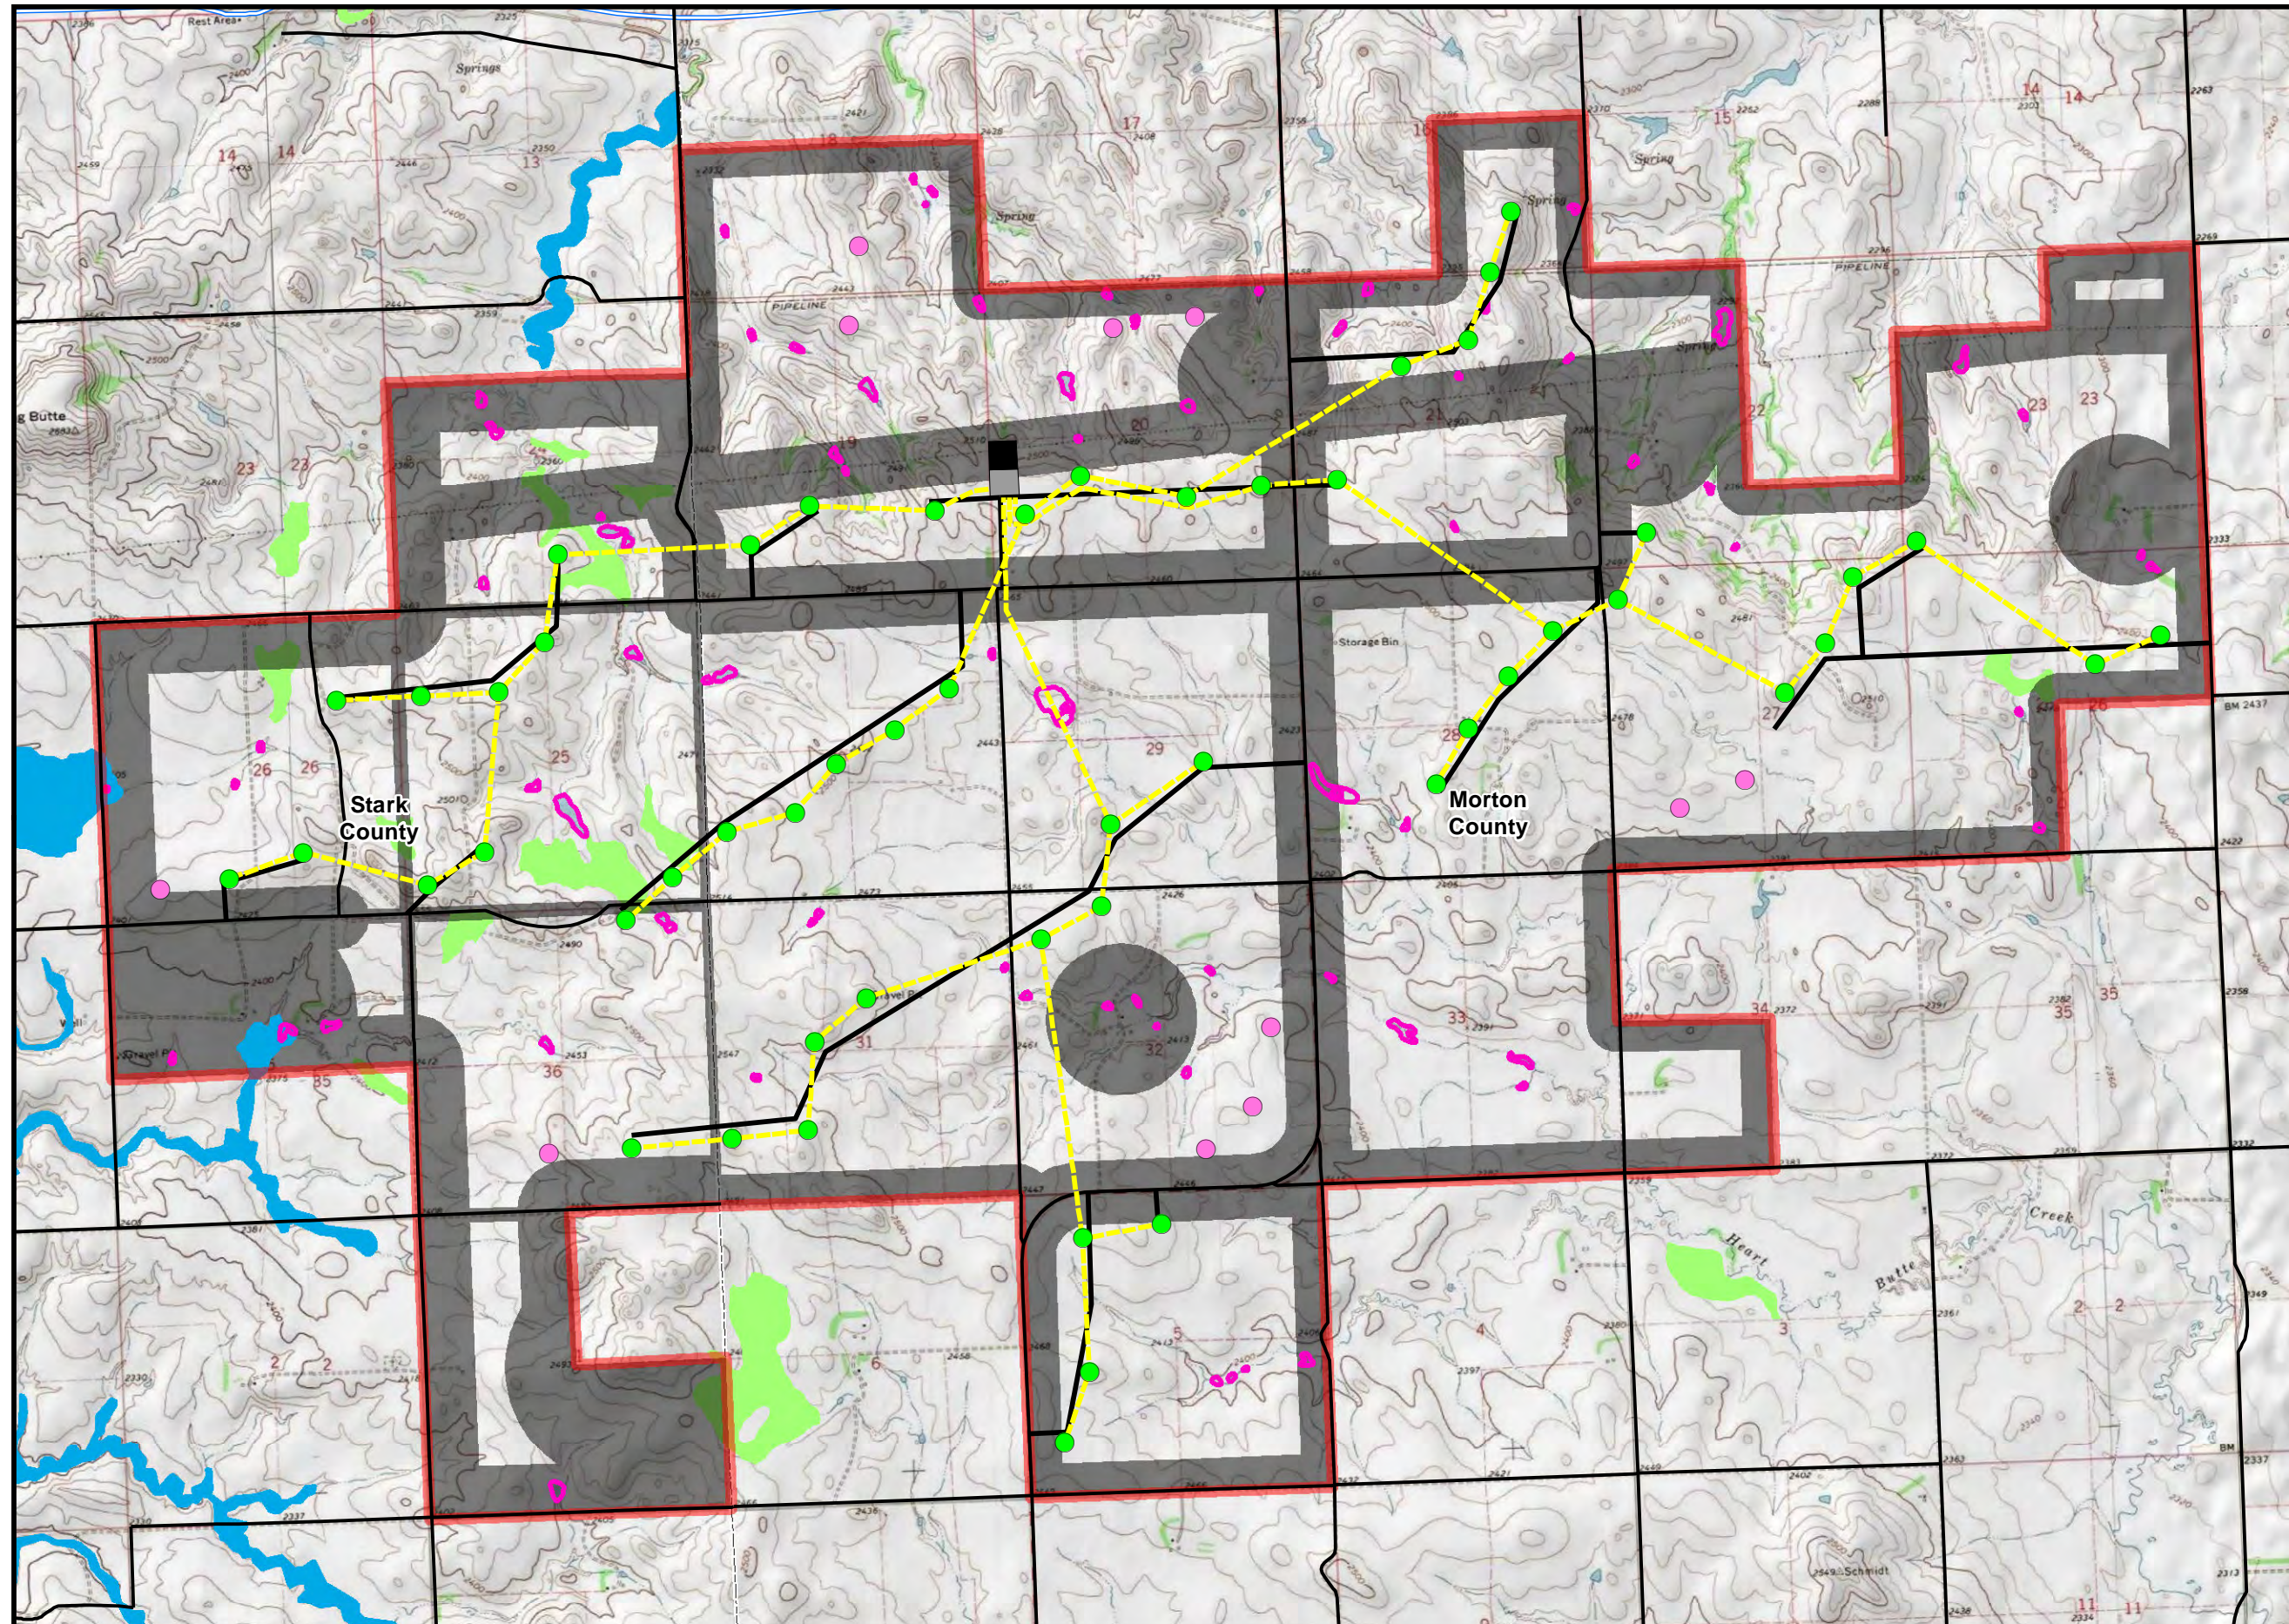

- Project Area
- Turbine Location\*
- Alternate Turbine Location\*
- Approximate Underground Collection System Routing
- Approximate Access Road Routing
- Proposed Interconnection
- Proposed Substation
- Exclusion Areas**
- Consolidated State and County Setbacks
- Prime Farmland
- Avoidance Areas**
- NWI wetland
- 100 Year Flood Zones
- Interstate Highway
- County Road
- County Boundary

Setbacks based on:  
Tower Height = 80m  
Rotor Diameter = 110m  
Max Turbine Height = 135m

\*The Project would utilize up to 55 Vestas V-110 turbines; however, 64 potential Vestas turbine locations are included on this figure to account for alternate locations that may be used.

