


P:\ICR\_PROJECTS\infinity\_wind\_Power\AntelopeHills\_Tier1\MXD\AntelopeHills\_AHT\InrCCC\_Exhibit6\_17111\_20141030.mxd - Last Saved 10/30/2014

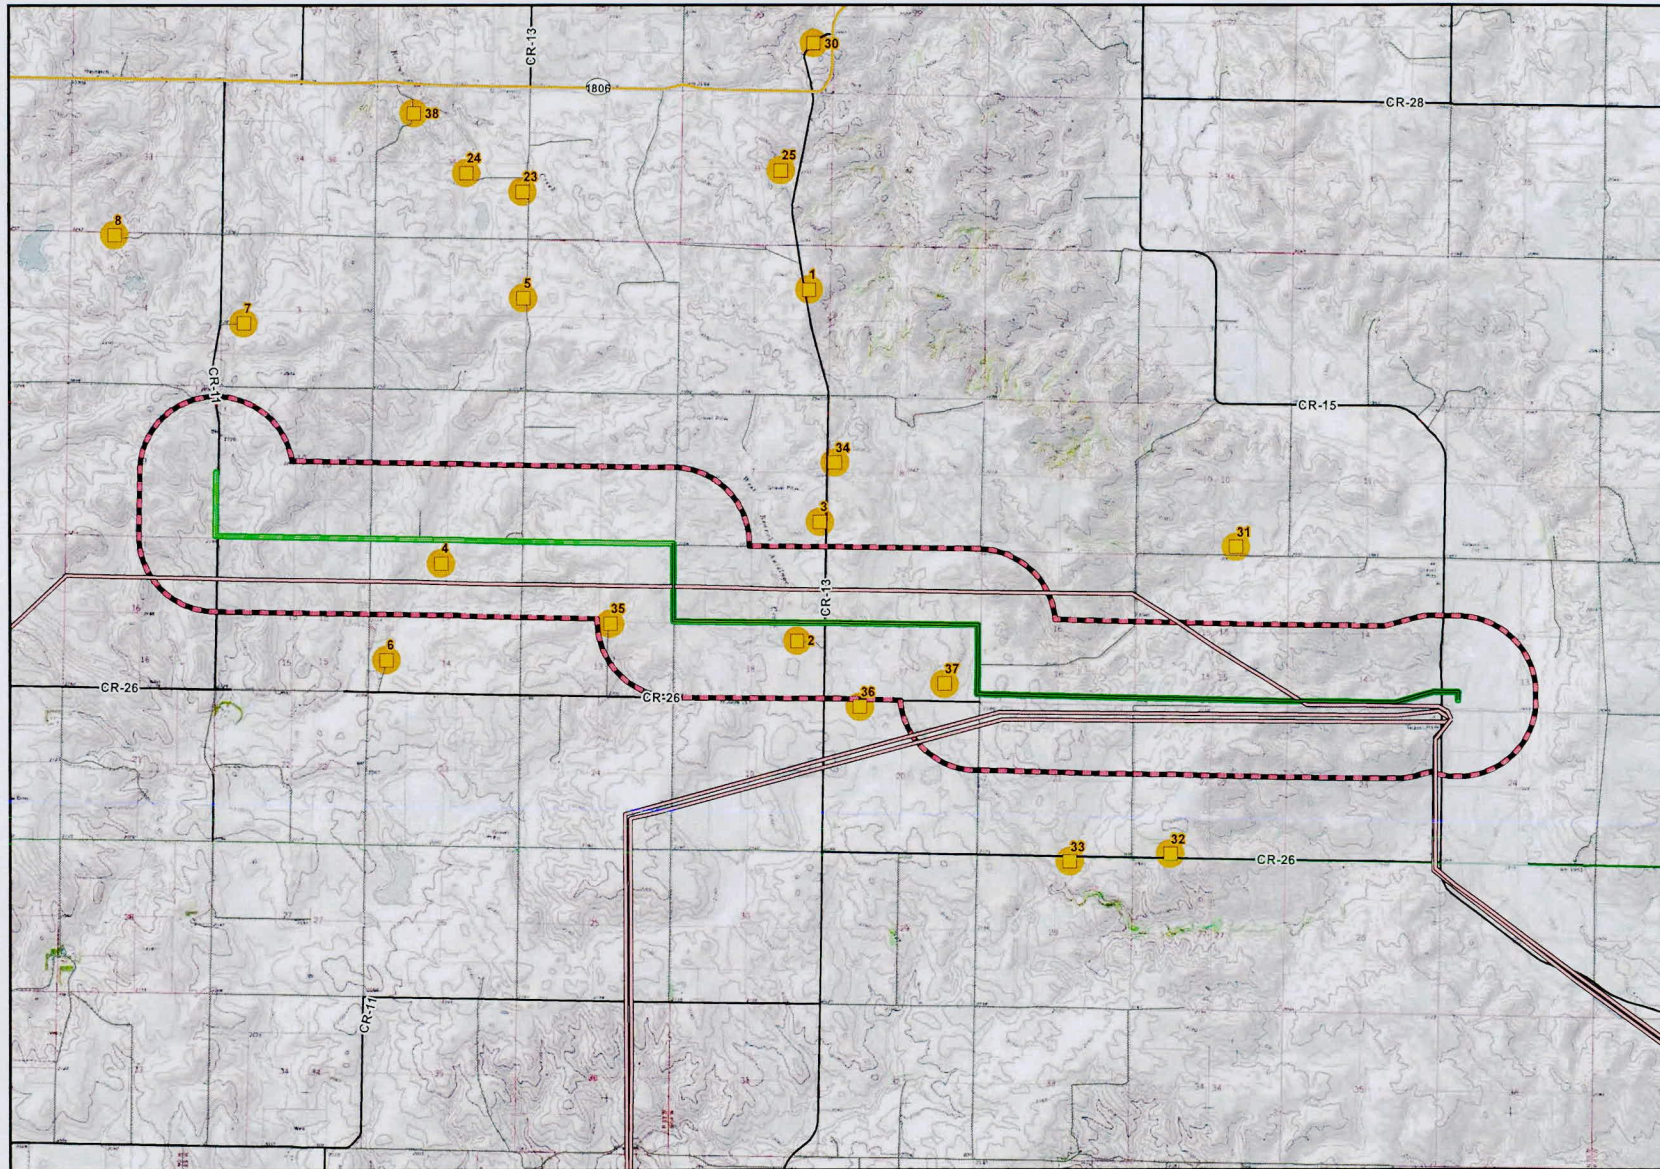


**Antelope Hills  
Transmission Line  
Application for North Dakota  
Certificate of  
Corridor Compatibility**

**Exhibit 6  
Exclusion and  
Avoidance Areas**

Mercer County, ND  
October 30, 2014

- Proposed Route
- Proposed Route ROW
- Proposed Corridor
- Residence
- 500 foot Avoidance Buffer
- Existing Transmission Line (Over 230 kV)



**30** **PU-14-678** Filed: 11/3/2014 Pages: 2  
Late-Filed Exhibit 6

## Antelope Hills Transmission Line

## Exhibit 6: Distance Between Occupied Resident and Proposed Route

ResidenceID	Distance to T-line (ft)
1	10,016
2	640
3	3,499
4	837
5	8,433
6	4,220
7	5,266
8	8,949
9	12,283
10	9,301
11	21,456
12	25,927
13	27,119
14	28,898
15	32,554
16	26,787
17	35,409
18	37,887
19	40,437
20	33,976
21	40,609
22	16,337
23	12,124
24	12,725
25	13,484
26	18,471
27	20,238
28	22,704
29	20,910
30	18,047
31	5,305
32	5,398
33	5,733
34	5,561
35	2,185
36	2,905
37	1,126
38	14,218