



Receipt Date: June 3, 2016
Cal. Date: June 3, 2016
Report Date: June 3, 2016

Report No.: 336033
Serial No.: None
Barcode: 013146

Calibration Certificate

MIDWEST PUMP & TANK
820 S HWY 281
ABERDEEN, SD 57402-2105
Contact: JERRY
Phone: 605-380-5185
PO Number: NONE
SOP: 19
Technician ID: 07

Item(s) Submitted: 5 Gallon Measure
Manufacturer: Seraphin
Material: Mild Steel
Type: Measure
Condition: Good
Temperature: 23.2 °C
Pressure: 735.8 mmHg
Relative Humidity: 53.1 %
Standard H₂O Temp.: 20.8 °C
Artifact H₂O Temp.: 20.7 °C

Nominal		Calibrated				
Volume (gal)		Volume (gal)	Error (in ³)	<i>k</i>	U (in ³)	CCE (°F)
5	As Found	4.9996	-0.10	2.06	0.24	0.0000186
	As Left	4.9996	-0.10			

Neck Calibration: No neck calibration was performed at this time.

This prover has been calibrated as a "to contain after wet down" vessel with a pour time of 30 seconds followed by a drain time of 10 seconds after cessation of full flow.

The prover listed above has been compared by volumetric transfer methods to the standards of the State of Minnesota using water as the calibration medium. The standards are traceable to the SI through NIST. Statistical process control charts indicate standards are currently in control. All gauges were sealed in place.

All tolerances and specifications were evaluated according to NIST Handbook 105-3 (2010). Uncertainty calculations contain the components in NIST SOP 19 and conform to the ISO/IEC Guide to the Expression of Uncertainty in Measurement (2008), including coverage factors (*k*) calculated at the approximate 95.45 % confidence level. Results apply to item identified in this report only.

CCE is the cubical coefficient of thermal expansion, and the reference temperature is 60 °F

Mark Nicollet
Mark Nicollet
Quality Manager

3 **WM-16-104** Filed: 6/21/2016 Pages: 6
Calibration report
Midwest Pump & Tank

Reviewed by:
Erik Alfvin
Erik Alfvin
Metrologist



Receipt Date: June 3, 2016
Cal. Date: June 3, 2016
Report Date: June 3, 2016

Report No.: 336034
Serial No.: 07-05607
Barcode: 013144

Calibration Certificate

MIDWEST PUMP & TANK
820 S HWY 281
ABERDEEN, SD 57402-2105
Contact: JERRY
Phone: 605-380-5185
PO Number: NONE
SOP: 19
Technician ID: 07

Item(s) Submitted: 5 Gallon Measure
Manufacturer: Seraphin
Material: Stainless Steel
Type: Measure
Condition: Excellent
Temperature: 23.2 °C
Pressure: 735.8 mmHg
Relative Humidity: 53.1 %
Standard H₂O Temp.: 20.8 °C
Artifact H₂O Temp.: 20.7 °C

Nominal		Calibrated			
Volume (gal)		Volume (gal)	Error (in ³)	<i>k</i>	U (in ³) CCE (°F)
5	As Found	4.9993	-0.17	2.06	0.24 0.0000265
	As Left	4.9993	-0.17		

Neck Calibration: No neck calibration was performed at this time.


This prover has been calibrated as a "to contain after wet down" vessel with a pour time of 30 seconds followed by a drain time of 10 seconds after cessation of full flow.

The prover listed above has been compared by volumetric transfer methods to the standards of the State of Minnesota using water as the calibration medium. The standards are traceable to the SI through NIST. Statistical process control charts indicate standards are currently in control. All gauges were sealed in place.

All tolerances and specifications were evaluated according to NIST Handbook 105-3 (2010). Uncertainty calculations contain the components in NIST SOP 19 and conform to the ISO/IEC Guide to the Expression of Uncertainty in Measurement (2008), including coverage factors (*k*) calculated at the approximate 95.45 % confidence level. Results apply to item identified in this report only.


CCE is the cubical coefficient of thermal expansion, and the reference temperature is 60 °F

Mark Nicollet


Quality Manager

Reviewed by:

Erik Alfvin


Metrologist



Receipt Date: June 3, 2016
Cal. Date: June 3, 2016
Report Date: June 3, 2016

Report No.: 336035
Serial No.: 1221
Barcode: 201254

Calibration Certificate

MIDWEST PUMP & TANK
820 S HWY 281
ABERDEEN, SD 57402-2105
Contact: JERRY
Phone: 605-380-5185
PO Number: NONE
SOP: 19
Technician ID: 07

Item(s) Submitted: 100 Gallon Prover
Manufacturer: Gas Service & Supply
Material: Stainless Steel (304)
Type: Bottom Zero
Condition: Excellent
Temperature: 23.1 °C
Pressure: 735.6 mmHg
Relative Humidity: 50.4 %
Standard H₂O Temp.: 13.8 °C
Artifact H₂O Temp.: 14.0 °C

Nominal		Calibrated				
Volume (gal)		Volume (gal)	Error (in ³)	<i>k</i>	U (in ³)	CCE (°F)
100	As Found	99.996	-0.9	2.01	3.3	0.0000288
	As Left	99.996	-0.9			

Neck Calibration: No neck calibration was performed at this time.

This prover has been calibrated as a "to contain after wet down" vessel with a drain time of 30 seconds after cessation of full flow.

The prover listed above has been compared by volumetric transfer methods to the standards of the State of Minnesota using water as the calibration medium. The standards are traceable to the SI through NIST. Statistical process control charts indicate standards are currently in control. All gauges were sealed in place.

All tolerances and specifications were evaluated according to NIST Handbook 105-3 (2010). Uncertainty calculations contain the components in NIST SOP 19 and conform to the ISO/IEC Guide to the Expression of Uncertainty in Measurement (2008), including coverage factors (*k*) calculated at the approximate 95.45 % confidence level. Results apply to item identified in this report only.

CCE is the cubical coefficient of thermal expansion, and the reference temperature is 60 °F

Mark Nicollet

Mark Nicollet
Quality Manager

Reviewed by:

Pete Whebbe

Pete Whebbe
Metrologist

United States Department of Commerce

National Institute of Standards and Technology

Certificate of Metrological Traceability For:

Minnesota

This laboratory has demonstrated evidence of an unbroken chain of metrological traceability of its standards to the international system of units (SI), documented measurement uncertainties, uses documented measurement procedures, successfully completed training and proficiency tests, documented calibration intervals, submitted a quality management system, and demonstrated suitable measurement assurance for the Scope listed on this certificate.

The Office of Weights and Measures Program assesses laboratories to NIST Handbook 143 - Program Handbook for State Weights and Measures Laboratories and ISO/IEC 17025:2005.

Scope

Mass Echelon II	Weight Carts	Volume Gravimetric, I
50 kg to 1 mg	10 000 lb to 2000 lb	20 L to 10 mL
1000 lb to 0.001 lb	Wheel Load Weighers	100 gal to 0.25 qt
4 oz to 0.03125 oz	20 000 lb to 2000 lb	Volume Transfer, II
Mass Echelon III	Railroad Test Cars	1500 gal to 5 gal
50 kg to 1 mg	110 000 lb to 80 000 lb	100 gal to 25 gal LPG
5000 lb to 0.001 lb		
4 oz to 0.03125 oz		



2016 to 2017

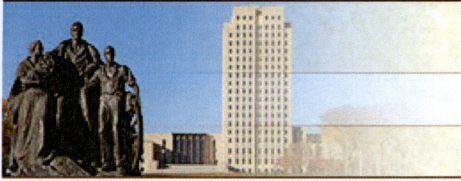
A handwritten signature in black ink, appearing to read "Carol T. Hockett".

Carol T. Hockett, Chief
NIST Office of Weights and Measures

Effective Dates: 2016-01-01 to 2017-12-31

North Dakota

nd.gov Official Portal for North Dakota State Government



SECRETARY OF STATE NORTH DAKOTA



[Home](#) | [Business Records Search](#)

MIDWEST PUMP & TANK

Trade Name

System ID: 9979400	Phone: (605) 225-0577
Status: Active	
Original File Date: 10/06/1995	Last Renewal Date: 10/06/2015

Nature of Business

SALES, SERVICE, REPAIR AND INSTALLATION OF PETROLEUM RELATED EQUIPMENT SUCH AS GAS PUMPS AND DISPENSERS, HOSES, NOZZLES, BULK TRUCKS, METERS, TANKS A ND TANK EQUIPMENT

Owners

J.W. PETRO SERVICE, INC.
820 S HWY 281
PO BOX 2105
ABERDEEN, SD 57402-2105

[Return to Search Results](#)

[Contact Us](#)

[Disclaimer](#)

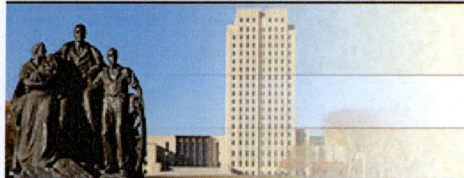
[Privacy Policy](#)

We use Secure Sockets Layer (SSL) encryption technology to ensure your information is secure and protected.


Will open a new window (pop-up).

W3C WAI AA, CSS, XHTML Compliant | Copyright 2006. All Rights Reserved. The State of North Dakota.

North Dakota

nd.gov Official Portal for
North Dakota State GovernmentNorth Dakota
LEGENDARY

SECRETARY OF STATE NORTH DAKOTA

[Home](#) | [Business Records Search](#)

J.W. PETRO SERVICE, INC.

Corporation Details

System ID: 33694800 **Phone:** (800) 874-9231
Type: FOREIGN BUSINESS CORPORATION
Status: Active & Good Standing
Original File Date: 02/22/2013 **Effective Date:** 02/22/2013
State of Origin: South Dakota

Nature of Business

SERVICE/REPAIR/SALES/INSTALL OF PETROLEUM RELATED EQUIPMENT

Principal Office

820 S HWY 281 PO BOX 2105 ABERDEEN, SD 57402-2105

Registered Agent

GIMBEL BUSINESS SERVICE LLC
147 MAIN ST
PO BOX 265
HAZELTON, ND 58544-0265
Established Date: Feb 22, 2013

Generate an Annual Report To File

To Generate a Annual Report form to be filed with the Secretary of State, select the appropriate year of the report you intend to file. This report does not contain details of a report previously filed with the Secretary of State. The annual report years reflected are an indication of the various report forms available in this site and is not an indication that an entity needs to file reports for all years. Missing years indicate that the forms for the missing year have not yet been deployed to the website, or have already been removed, and can be obtained by contacting the Secretary of State.

[2016](#) (generates a forms-fillable pdf in a new pop-up window)

[Return to Search Results](#)

[Contact Us](#)[Disclaimer](#)[Privacy Policy](#)

We use Secure Sockets Layer (SSL) encryption technology to ensure your information is secure and protected.

Will open a new window (pop-up).

W3C WAI AA, CSS, XHTML Compliant | Copyright 2006. All Rights Reserved. The State of North Dakota.