


Metering (for illustrative purposes)

Injection capacity capped @ max wind output

1. Battery load will be settled at Wholesale Storage Load (WSL) meter.
2. Bowman generation to grid will be settled via Gen & Site Load Meter

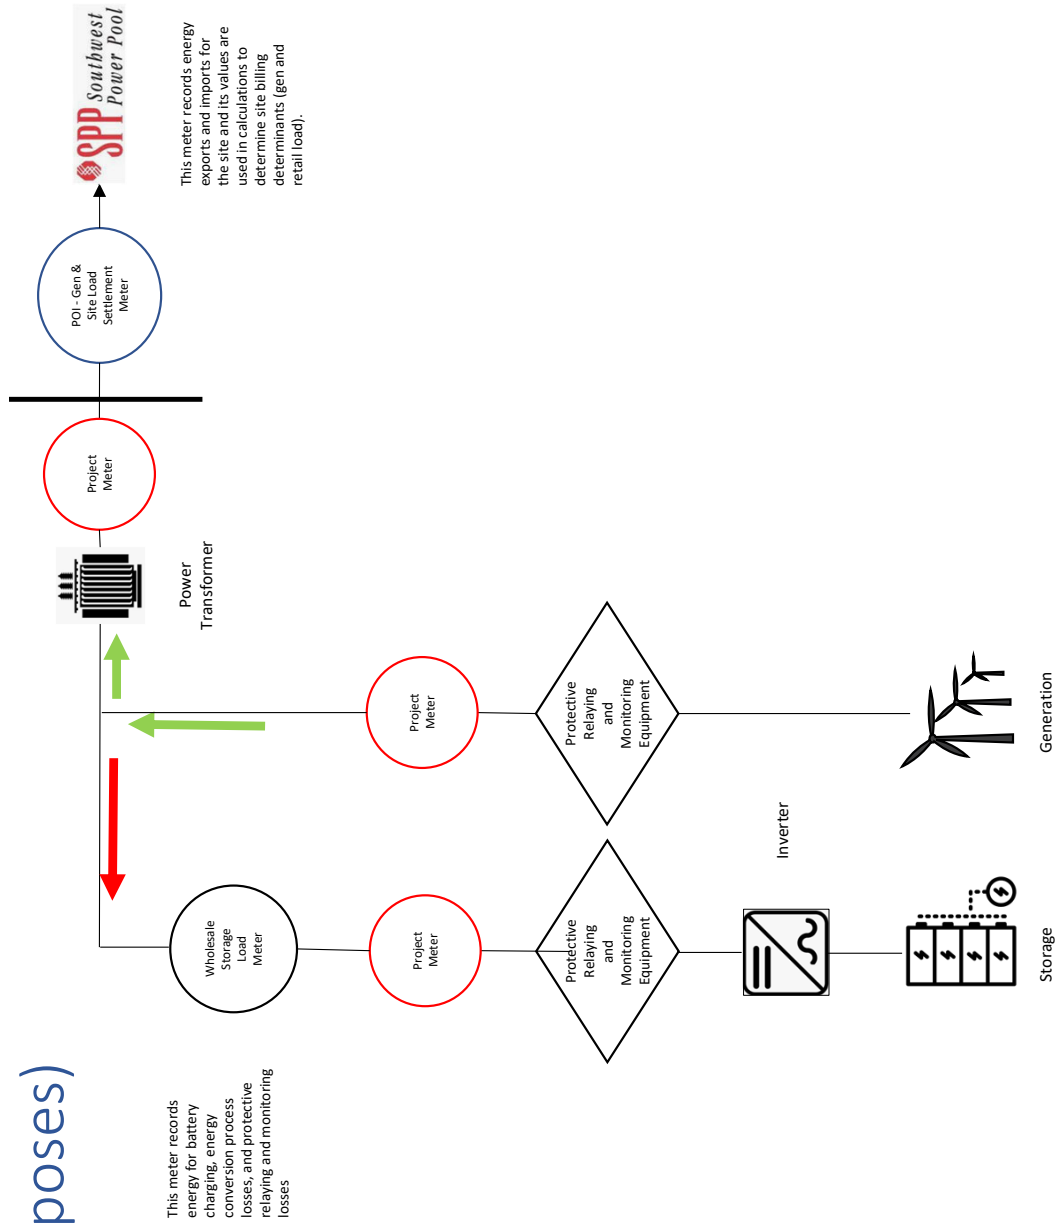

Notes:

→ Generation

→ Charging / Load

○ Local meter for shadow settlements